
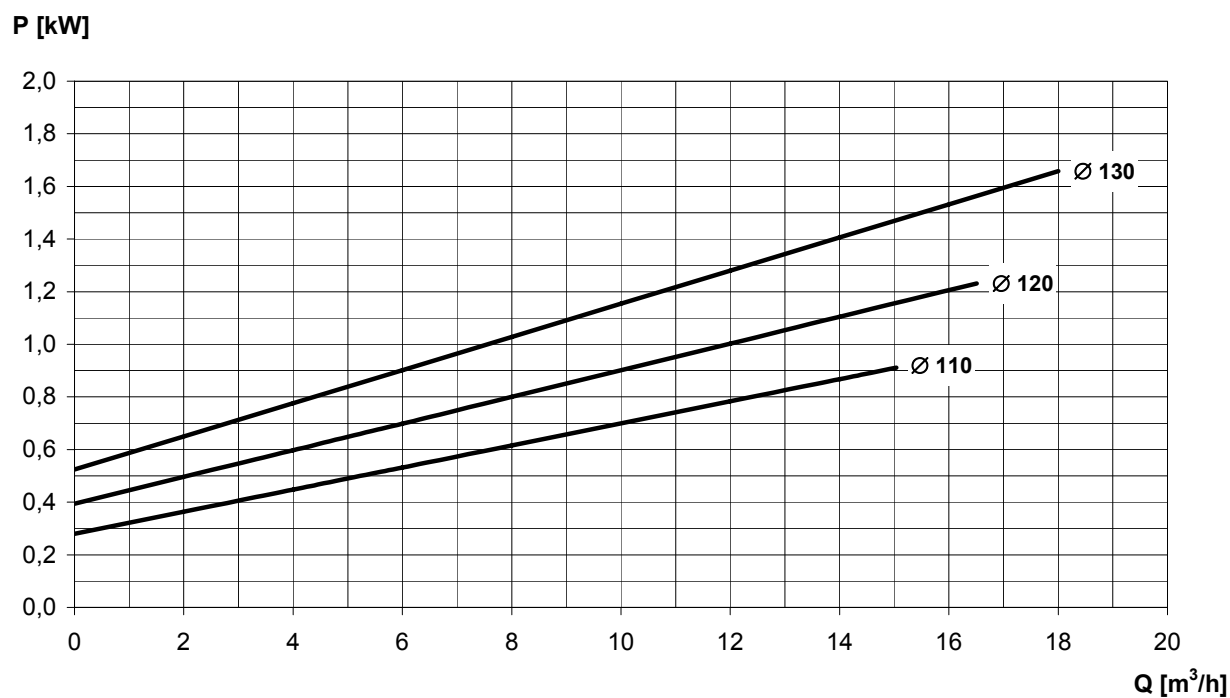


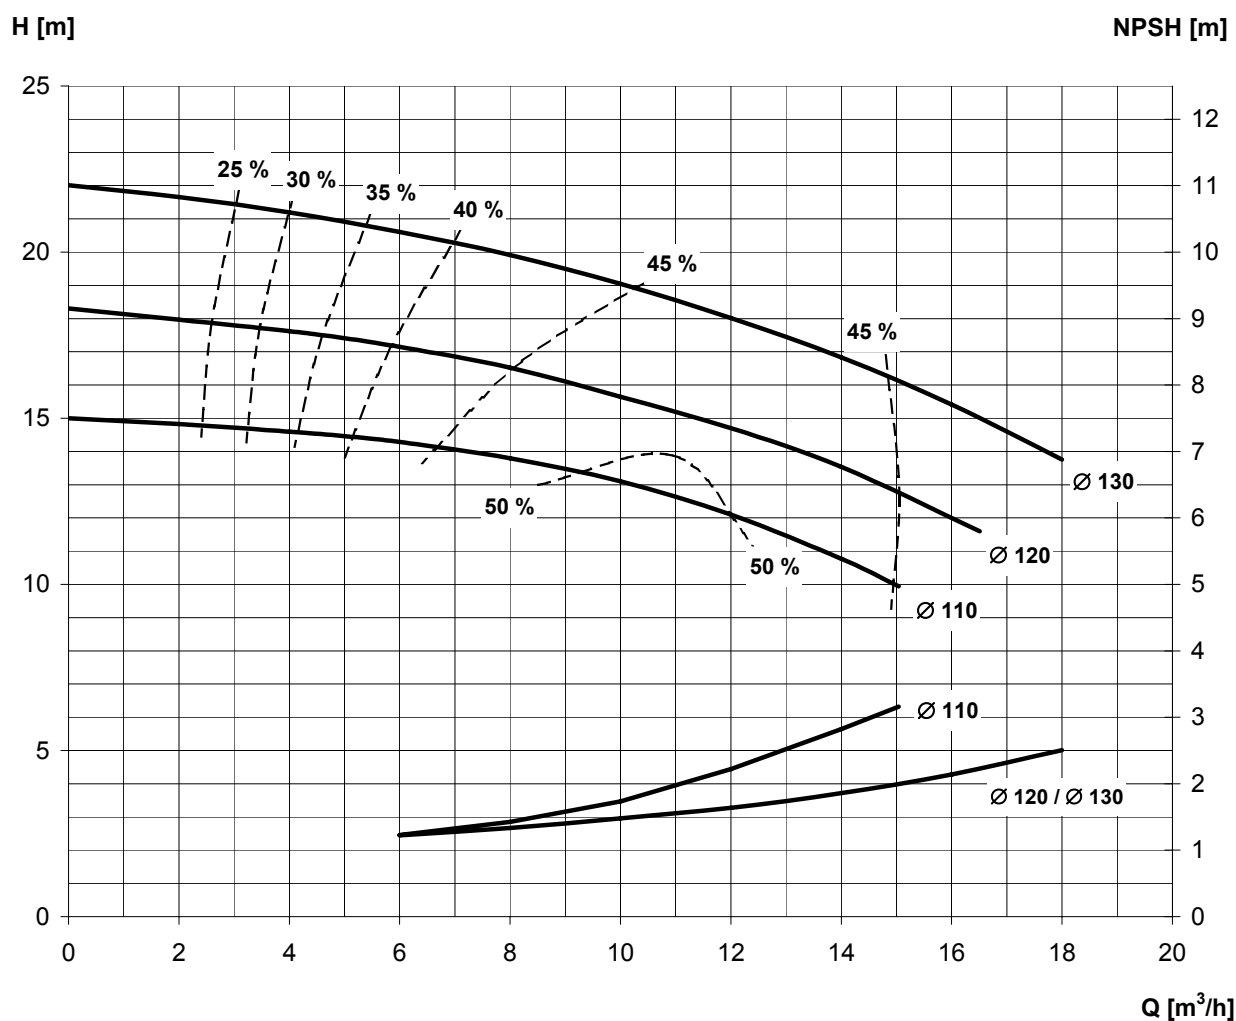

Permissible power fluctuations  $\pm 5\%$   
The test applies to water at 20

Name : Frodog  
Date : 08.18.21

**HPC10**

Inlet : DN 50  
Outlet: DN 40

$n = 2900 \text{ min}^{-1}$